


SUPPLY AIR FILTER AND RETURN AIR DUCT SMOKE DETECTION SYSTEM

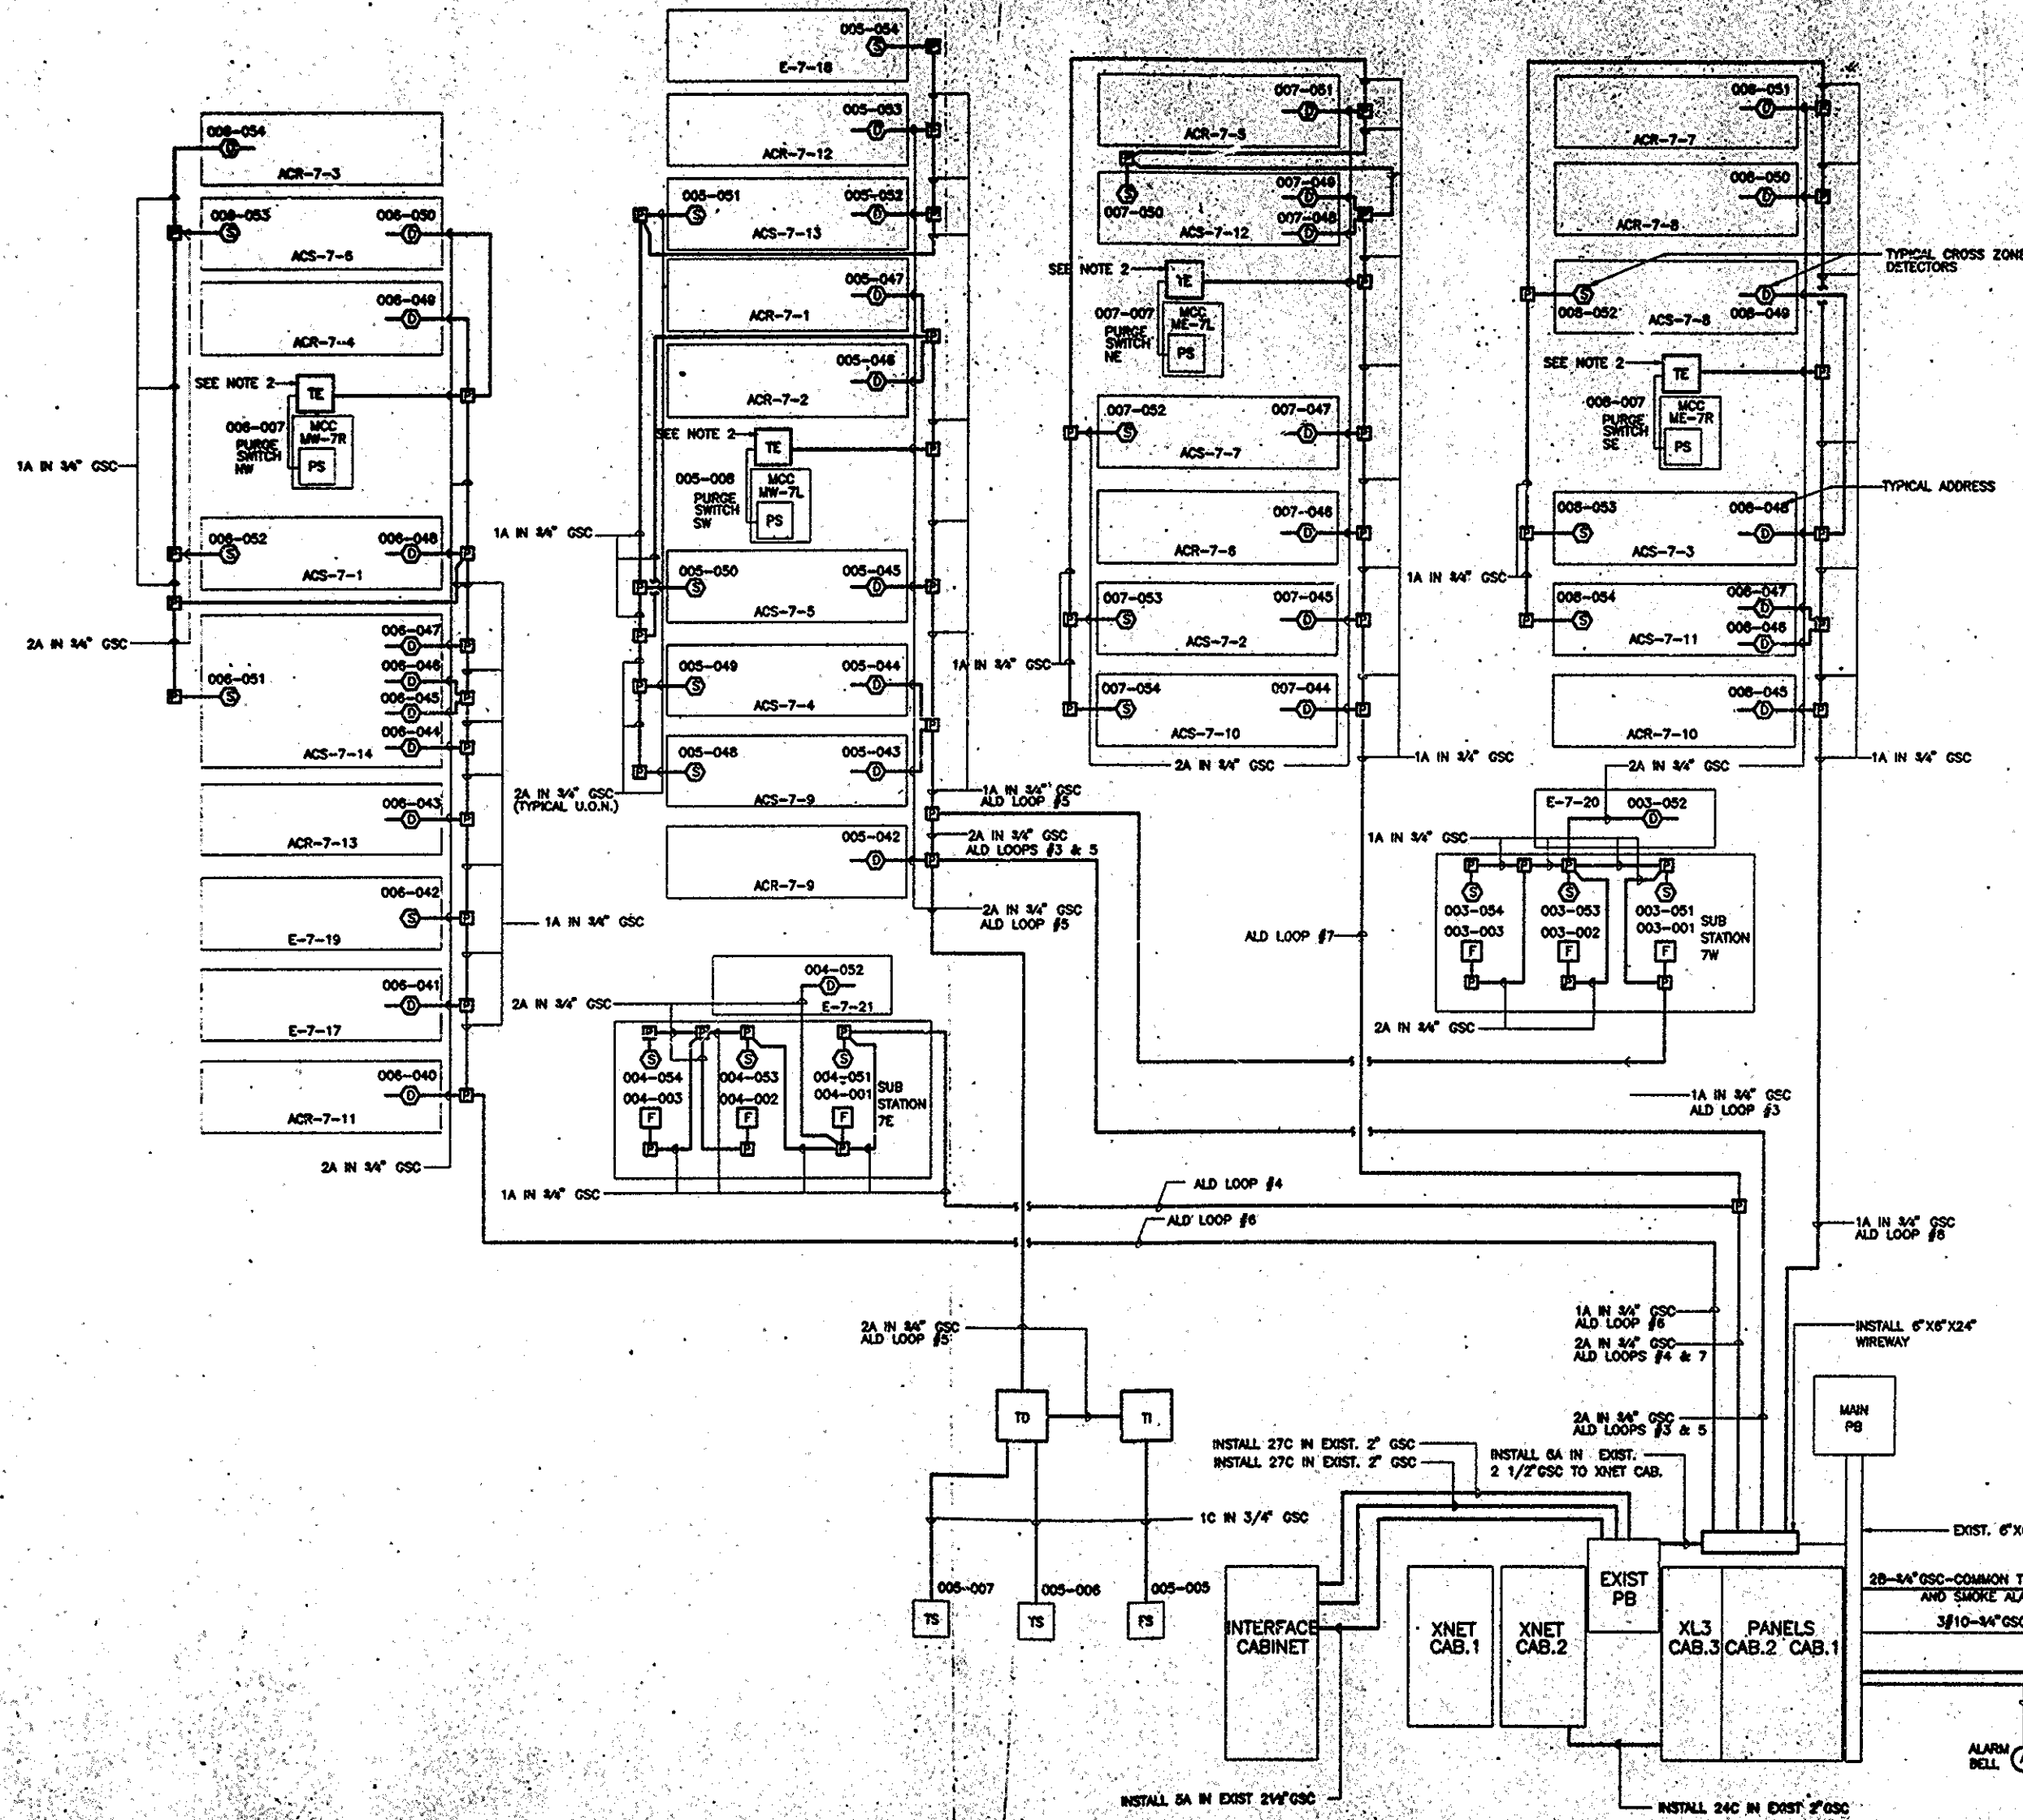

NOTES

1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG E-1.
2. REMOVE TRX AND E.O.L. FROM EXIST. BOX LOCATED ABOVE MCC AND INSTALL TR-86 AND NEW E.O.L. DISCONNECTION AND RECONNECTION OF PURGE SWITCH CIRCUITRY SHALL BE DONE BY THE CONTRACTOR IN THE PRESENCE OF THE ENGINEER.
3. FOR 7th FLOOR MER PLAN, SEE DWG E-27.
4. FOR 7th FLOOR MER REMOVAL PLAN, SEE DWG E-28.

Sheet 28 of 55

THE PORT AUTHORITY
OF NY & NJ

ENGINEER PROGRAM MANAGER
WORLD TRADE
Center
ELECTRICAL ENGINEER

No. Date Revision Approved

Engineering Department
Design Division

The World Trade
Center

Title
FIRE ALARM SYSTEM
PHASE III
XL3 CONVERSION
ELECTRICAL
2 WTC
7th FLOOR MER
FIRE ALARM SYSTEM
RISER DIAGRAM

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

ROYZMAN
FELDSTEIN
Designed by
ROYZMAN
Drawn by
A.S.
Checked by

Date 5-20-99 Scale NONE

Contract Number Drawing Number

WTC-881.082 E-28

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-861.081-1 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.
DATE 2/1/00
DATE 2/1/00
CONTRACT ENGINEER
ENGINEERING PROGRAM MGR.